ICC-ES Evaluation Report

ESR-3537

Reissued June 2026

Revised October 2026

This report remains under an active continuous compliance program through the end of June 2027

This report also contains:

- **CA Supplement w/ Exterior Wildfire Exposure**

ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.

Copyright © 2026 ICC Evaluation Service, LLC. All rights reserved.

DIVISION: 07 00 00—THERMAL AND MOISTURE PROTECTION Section: 07 31 13—Asphalt Shingles	REPORT HOLDER: CERTAINTEED LLC	EVALUATION SUBJECT: CERTAINTEED ASPHALT SHINGLES	

1.0 EVALUATION SCOPE

Compliance with the following codes:

- 2024[1], 2021, 2018, 2015, 2012, and 2009 *International Building Code*® (IBC)
- 2024[1], 2021, 2018, 2015, 2012, and 2009 *International Residential Code*® (IRC)
- 2013 *Abu Dhabi International Building Code* (ADIBC)[†]

[†]The ADIBC is based on the 2009 IBC. 2009 IBC code sections referenced in this report are the same sections in the ADIBC.

[1]Main references in this report are for the 2024 IBC and IRC, unless noted otherwise. See Table 2 for applicable sections of the code for previous IBC and IRC editions.

Properties evaluated:

- Weather resistance
- Fire classification
- Wind resistance

2.0 USES

The CertainTeed asphalt shingles described in this report are alternatives to asphalt shingles complying with 2021 IBC Section 1507.2 and 2021 IRC Section R905.2, and are Class A roof coverings when installed as described in this report.

3.0 DESCRIPTION

3.1 General:

CertainTeed asphalt shingles are available as three-tab, four-tab and laminated asphalt shingle roof covering materials, and have been qualified for wind resistance as noted in Section 4.3. See Table 1 and Figure 1 for recognized product names, shingle types, manufacturing locations, overall dimensions, installed weights, maximum exposure to the weather, and fastening details. The shingles are self-sealing by means of adhesive strips located on either the weather side or the underside. See Figure 1 for adhesive strip location for field shingles and Starter Strip shingles.

3.2 Three-tab Shingles and Four-tab Shingles:

Three-tab and four-tab shingles are composed of a single layer of fiberglass mat, impregnated and coated with asphalt on both sides, and surfaced with mineral roofing granules on the weather side and a mineral release agent on the back side.

3.3 Laminated Shingles:

Laminated shingles, including two-layer laminated, three-layer laminated and tri-laminate laminated shingles, are composed of multiple thicknesses of coated and surfaced fiberglass mat, cut and bonded together in different patterns. The weather side is surfaced with mineral roofing granules, and the back side is surfaced with a mineral release agent.

3.4 Accessory Shingles:

3.4.1 Hip and Ridge Shingles: Hip and ridge shingles are factory-made shingles to be used for covering hips and ridges. The hip and ridge shingles are composed of the same materials as the roof shingles. Some of the hip and ridge shingles have perforations that extend from the top of the cut-out to the top of the shingle, which facilitate the tearing of the shingle into three or four equal pieces. Others are manufactured as single hip and ridge units.

3.4.2 Starter Strip Shingles: Starter Strip shingles are factory-made shingles to be used as the starter course (under the first course of roof shingles). The Starter Strip shingles are composed of the same materials as the roof shingles. The shingles are supplied in 7-inch-by-36-inch-long (178 by 914 mm); 10-inch-by-36-inch-long (254 by 914 mm); or 7-inch-by-39 3/8-inch-long (178 by 1000 mm) strips. As an alternative to factory-made starter strips, starter strips can be formed by removing the lower tab portions of the factory-made shingles, except in the case of the Presidential Shake and Presidential Shake TL shingles. For Presidential Shake and Presidential Shake TL shingles, the Presidential Starter shingles consist of one 13 1/4-inch-wide-by-40-inch-long (337 mm by 1016 mm) base shingle and one 11 1/4-inch-wide-by-40-inch-long (286 mm by 1016 mm) base shingle.

3.5 Fasteners:

Fasteners must comply with ASTM F1667 and must be minimum No. 12 gage [0.105-inch-diameter (2.67 mm)] shank, 3/8-inch-diameter-head (9.5 mm), galvanized steel, stainless steel, aluminum or copper roofing nails. Fasteners must be of sufficient length to penetrate into the sheathing 3/4 inch (19.1 mm), or through the sheathing, whichever is less.

3.6 Underlayment:

Under the 2024 IBC, the roof underlayment must be in accordance with Section 1507.2.3. Under the 2024 IRC, the roof underlayment must be in accordance with Section R905.1.1 and Table R905.1.1(1). The roof underlayment must comply with ASTM D226 Type I or Type II, ASTM D4869 Type I or Type II, ASTM D6757, ASTM D1970, or ASTM D8257. As an alternative, a roof underlayment listed in a current ICC-ES evaluation report as complying with AC160 or AC188 may be used, provided it is described as being intended for use with Class A asphalt shingles. In areas where there has been a history of ice forming along the eaves causing a backup of water, ice dam protection in accordance with 2024 IBC Section 1507.2.7 or 2024 IRC Section R905.2.7 must be provided.

3.7 Asphalt Cement:

Asphalt roofing cement must comply with ASTM D4586, Type I, Class I, or Type II, Class I.

4.0 DESIGN AND INSTALLATION

4.1 New construction:

4.1.1 General: When installed on new construction in accordance with this section, the shingles are a Class A roof covering. The shingles must be installed in accordance with 2024 IBC Section 1507.2 or 2024 IRC Section R905.2, except as noted in this report. The roof deck must be code-complying, minimum 3/8-inch-thick (9.5 mm), exterior-grade plywood; 7/16-inch-thick (11.1 mm) oriented strand board (OSB); or nominally 1-inch-by-6-inch (25 by 152 mm) lumber installed as solid sheathing conforming to 2024 IBC Section 2304.8.2 and 2308.11.9. Minimum roof slope must be 2:12 (16.7%). The maximum roof slope must be as stated in Section 4.1.2 of this report. Installation instructions are included as part of the identification label attached to each bundle of shingles (See Section 7.0.). The roof underlayment must be as described in Section 3.6 of this report, and applied in accordance with 2024 IBC Table 1507.1.1(2), or 2024 IRC Section R905.1.1, Tables R905.1.1(2) and R905.1.1(3) and Section R905.2.3, as applicable.

4.1.2 Application:

4.1.2.1 Eave and Rake Edges of the Roof:

4.1.2.1.1 Roof Slopes of 2:12 to 21:12 (16.7% to 175%): Starter Strip shingles must be attached to the eave edges with four or five fasteners, equally spaced along the nail line as shown in Figure 1. The Starter Strip shingles must overhang the eave and rake edges by 1/2 to 3/4 inch (12.7 to 19.1 mm).

4.1.2.1.2 Roof Slopes Greater than 21:12 (175%): Starter Strip shingles must be attached to the eave edges with four or five fasteners, equally spaced along the nail line as shown in Figure 1. The Starter Strip shingles must overhang the eave and rake edges by 1/2 to 3/4 inch](12.7 to 19.1 mm).

4.1.2.2 Field of the Roof: The first course of field shingles must be installed over the starter course. Each course of shingles must be offset from the preceding course as specified in Table 1. Fastening details, including number and location of fasteners, and maximum exposure to the weather, are described in Table 1 and Figure 1.

Methods of fastening for roof slopes of 2:12 (16.7%) to 21:12 (175%) and for roof slopes greater than 21:12 (175%) are as shown in Figure 1 for the standard and high-wind applications. For slopes greater than 21:12 (175%), the shingles must also be hand-sealed as described in Section 4.1.2.4.

4.1.2.3 High Wind Fastening: Shingles must be fastened with four or five No. 12 gage roofing nails, described in Section 3.5, as shown in Figure 1, when the shingles are installed under the following conditions:

4.1.2.3.1 2024 IBC: When the roof is installed in applications in hurricane-prone regions where the maximum wind speed, *V*, is 130 mph (209 km/hr) or greater; and when the roof is installed in applications outside hurricane-prone regions where the maximum wind speed, *V*, is 140 mph (225 km/hr) or greater.

4.1.2.3.2 2021 and 2018 IBC: When the roof is installed in applications where the maximum design wind speed, *V*, is 140 mph (225 km/hr) or greater.

4.1.2.3.3 2015 and 2012 IBC: When the roof is installed in applications where the ultimate design wind speed, V_{ult}, is 140 mph (225 km/hr) or greater.

4.1.2.3.4 2009 IBC: When the roof is installed in applications where the basic wind speed is 110 mph (177 km/h) or greater.

4.1.2.3.5 2024, 2021, 2018 and 2015 IRC: When the roof is installed in applications where the ultimate design wind speed, V_{ult}, is 140 mph (225 km/hr) or greater.

4.1.2.3.6 2012 and 2009 IRC: When the roof is installed in areas where the basic wind speed is 110 mph (177 km/h) or greater.

4.1.2.4 Shingle Sealing: In colder climates or wind regions where it is questionable whether the factory-applied adhesive will activate and seal the shingles, the shingles must be hand-sealed to the satisfaction of the code official. Hand-sealing must consist of applying a minimum of four 1-inch-diameter (25.4 mm) spots of asphalt roofing cement to the unexposed surface of the underlying course of shingles, equally spaced across each shingle. For three-tab and four-tab shingles, one spot of asphalt roofing cement must be placed under each corner of each tab (two spots per tab); the tab must then be pressed into the cement. For laminated shingles, four equally spaced spots of asphalt roofing cement must be placed under the exposed portion of the shingle; the shingle must then be pressed into the cement.

4.1.2.5 Hip and Ridge Shingles: Hip and ridge shingles must be placed evenly over hips and ridges (or over shingle-over ridge vents), and fastened to the roof deck with two fasteners, located on either side of the shingle, along the nail line as shown in Figure 1.

4.1.3 Valley Construction and other Flashing: For open valleys, corrosion-resistant metal valley flashing must be centered and placed vertically in the valley over the smooth-surfaced roof roofing, or specialty underlayment.

Corrosion-resistant metal valley flashing must be as follows:

- IBC: A minimum of 24 inches (610 mm) wide, complying with 2024 IBC Table 1507.2.8.2.
- IRC: A minimum of 24 inches (610 mm) wide, complying with 2024 IRC Table R905.2.8.2.

Other flashing must be in accordance with 2024 IBC Sections 1503.2 and 1507.2.8 or 2024 IRC Sections R903.2 and R905.2.8, as applicable.

4.2 Installation-Reroofing:

When installed over existing Class A or Class C asphalt shingle roofs in accordance with this section (Section 4.2), the shingle products are recognized as Class A roof coverings. The existing wood or asphalt shingle roof covering must be inspected in accordance with provisions and limitations of 2024 IBC Section 1512 or 2024 IRC Section R908, as applicable. Prior to the reroofing over existing asphalt shingles, hip and ridge covering must be removed. Prior to the reroofing over existing wood shingles, hip and ridge covering must be removed and a single layer of ASTM D226, Type II, nonperforated, felt underlayment must be installed over the existing wood shingles. Except as noted in this section, the shingles must be installed in accordance with Section 4.1 of this report. Fasteners must be of sufficient length to penetrate 3/4 inch (19.1 mm) into the

sheathing, or through the sheathing, whichever is less. Valley flashing and other flashings must comply with Section 4.1.3 of this report and the following, as applicable:

- IBC: 2024 IBC Sections 1512.4 and 1512.5.
- IRC: 2024 IRC Sections R908.5 and R908.6.

The following asphalt shingles may be installed over existing wood shingle roofs provided all of the conditions specified above are met:

Grand Manor, Carriage House, Presidential Shake TL, Presidential Shake, Presidential Shake IR, Presidential Solaris, Presidential TL Solaris, Landmark TL, Landmark TL Solaris, Landmark Premium, Landmark Premium Solaris, Landmark Solaris, Landmark Pro, Landmark Pro Solaris, Landmark, XT-25, Highland Slate, Highland Slate IR, Patriot, Shangle Ridge, Cedar Crest, Mountain Ridge, Belmont and Shadow Ridge.

4.3 Wind Resistance:

CertainTeed asphalt shingles have been tested in accordance with ASTM D7158 and are classified as Class H. They qualify for use in locations as shown in 2024 IBC Table 1504.2 and 2024 IRC Table R905.2.4.1. Installation must be in accordance with 2024 IBC Section 1507.2.6 or 2024 IRC Section R905.2.6, as applicable.

5.0 CONDITIONS OF USE:

The CertainTeed Asphalt Shingle Roof Covering Systems described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

5.1 The shingles must be manufactured, identified, and installed in accordance with the applicable codes, this report, and the manufacturer's published installation instructions. If there is a conflict between the manufacturer's published installation instructions and this report, this report governs.

5.2 The products are manufactured in Avery, Ohio (AV); Ennis, Texas (EN); Fremont, California (FR); Jonesburg, Missouri (JB); Norwood, Massachusetts (NW); Oxford, North Carolina (OX); Peachtree City, Georgia (PT); Portland, Oregon (PO); Shakopee, Minnesota (SH); Shreveport, Louisiana (SP); and Wilmington, California (WI), under a quality-control program with inspections by ICC-ES.

6.0 EVIDENCE SUBMITTED

Data in accordance with the ICC-ES Acceptance Criteria for Alternative Asphalt Roofing Shingles (AC438), dated June 2017 (editorially revised February 2025).

7.0 IDENTIFICATION

7.1 The ICC-ES mark of conformity, electronic labeling, or the evaluation report number (ICC-ES ESR-3537) along with the name, registered trademark, or registered logo of the report holder (CertainTeed LLC) must be include in the product label.

7.2 In addition, each bundle of shingles bears a label with the name and address of the report holder (see Section 7.3); the manufacturing plant location (city and state – see Table 1); the product brand name; the Class A roof classification; the installation instructions; the evaluation report number (ESR-3537); and a reference indicating compliance with ASTM D7158. Additionally, each bundle of shingles is marked with the area of the roof surface covered and the style, type and color of the product.

7.3 The report holder's contact information is the following:

CERTAINTEED LLC
20 MOORES ROAD
MALVERN, PENNSYLVANIA 19355
(610) 893-6096
www.certainteed.com

TABLE 1—PRODUCT DESCRIPTIONS AND MANUFACTURING LOCATIONS

PRODUCTS[1]	SHINGLE TYPE	PLANT LOCATION	PLANT DESIGNATION	DIMENSIONS (width x height) (inches)	MAXIMUM EXPOSURE TO THE WEATHER (inches)	LOCATION OF NAIL "LINE"[2] (distance above shingle butt) (inches)
Grand Manor	3-Layer Laminated	Oxford, NC	OX	36 x 18	8	$8^5/_8$
Carriage House	2-Layer Laminated	Oxford, NC	OX	36 x 18	8	$8^5/_8$
Presidential Shake TL	Tri-Laminate	Fremont, CA; Shakopee, MN	FR SH	40 x $14^1/_4$	4	9
Presidential Shake	Laminated	Fremont, CA; Shakopee, MN	FR SH	40 x $14^1/_4$	4	9
Presidential IR	Laminated Impact Resistant	Shakopee, MN	SH	40 x $14^1/_4$	4	9
Presidential Solaris	Laminated	Fremont, CA	FR	40 x $14^1/_4$	4	9
Presidential TL Solaris	Tri-Laminate	Fremont, CA	FR	40 x $14^1/_4$	4	9
Landmark TL	Tri-Laminate	Fremont, CA; Oxford, NC	FR OX	40 x $13^1/_4$	$5^5/_8$	$6^1/_{16}$
Landmark TL Solaris	Tri-Laminate	Fremont, CA; Oxford, NC	FR OX	40 x $13^1/_4$	$5^5/_8$	$6^1/_{16}$
Landmark Premium	Laminated (Metric)	Avery, OH Norwood, MA Oxford, NC Peachtree City, GA Portland, OR Shakopee, MN Shreveport, LA Wilmington, CA	AV NW OX PT PO SH SP WI	$38^3/_4$ x $13^1/_4$	$5^5/_8$	$6^1/_8$
Landmark Premium Solaris	Laminated (Metric)	Wilmington, CA	WI	$38^3/_4$ x $13^1/_4$	$5^5/_8$	$6^1/_8$
Landmark Solaris	Laminated (Metric)	Peachtree, GA Portland, OR Wilmington, CA	PT PO WI	$38^3/_4$ x $13^1/_4$	$5^5/_8$	$6^1/_8$
Landmark Pro	Laminated (Metric)	Avery, OH Jonesburg, MO Norwood, MA Oxford, NC Peachtree City, GA Portland, OR Shakopee, MN Shreveport, LA Wilmington, CA	AV JB NW OX PT PO SH SP WI	$38^3/_4$ x $13^1/_4$	$5^5/_8$	$6^1/_8$
Landmark Pro Solaris	Laminated (Metric)	Wilmington, CA	WI	$38^3/_4$ x $13^1/_4$	$5^5/_8$	$6^1/_8$
Landmark	Laminated (Metric)	Avery, OH Ennis, TX Jonesburg, MO Norwood, MA Oxford, NC Peachtree City, GA Portland, OR Shakopee, MN Shreveport, LA Wilmington, CA	AV EN JB NW OX PT PO SH SP WI	$38^3/_4$ x $13^1/_4$	$5^5/_8$	$6^1/_8$
XT-25	3-Tab (Standard)	Avery, OH Norwood, MA Oxford, MN Shakopee, MN Shreveport, LA	AV NW OX SH SP	36 x 12	5	$5^5/_8$

For **SI:** 1 inch = 25.4 mm.

TABLE 1—PRODUCT DESCRIPTIONS AND MANUFACTURING LOCATIONS (Continued)

PRODUCTS[1]	SHINGLE TYPE	PLANT LOCATION	PLANT DESIGNATION	DIMENSIONS (width x height) (inches)	MAXIMUM EXPOSURE TO THE WEATHER (inches)	LOCATION OF NAIL "LINE"[2] (distance above shingle butt) (inches)
Highland Slate	4-Tab	Oxford, NC	OX	36 x 18	8	$9^3/_8$
Highland Slate IR	4-Tab Impact Resistant	Oxford, NC	OX	36 x 18	8	$9^3/_8$
Patriot	Laminated (Metric)	Ennis, TX Jonesburg, MO Ocford, NC	EB JB OC	$38^3/_8$ x $13^1/_4$	$5^5/_8$	$6^1/_8$
Belmont	4-Tab Laminated Impact Resistant	Oxford, NC	OX	36 x 18	8	8⅝

For **SI:** 1 inch = 25.4 mm.

NOTES:
1. Includes algae-resistant (AR) versions.
2. Nail "Line" - Distance from lowermost lowest edge of shingle to target nail location.
3. Shingle butt location varies up to 1 inch. Dimensions shown for shingle height and nail “line” location are averages.

TABLE 1—PRODUCT DESCRIPTIONS AND MANUFACTURING LOCATIONS (Continued)

ACCESSORIES					
PRODUCTS	**SHINGLE TYPE**	**PLANT LOCATION**	**PLANT DESIGNATION**	**DIMENSIONS (width x height) (inches)**	**MAXIMUM EXPOSURE TO THE WEATHER (inches)**
Shangle Ridge	Hip and Ridge	Oxford, NC	OX	12 x 18	8
Cedar Crest	Hip and Ridge	Oxford, NC	OX	12 x 12	8
Mountain Ridge	Hip and Ridge	Fremont, CA	FR	8 x 12 & 10 x12	8
Shadow Ridge	Hip and Ridge (Standard)	Avery, OH Norwood, MA Oxford, NC Shakopee, MN	AV NW OX SH	12 x 12	5
Shadow Ridge	Hip and Ridge (Metric)	Portland, OR	PO	$9^7/_8$ x $13^1/_4$	$5^5/_8$
Presidential Starter	Starter Shingle	Portland, OR Fremont, CA	OR FR	40 x $13^1/_4$, bottom layer; 40 x $11^1/_4$, top layer	4 (top layer)
Presidential Starter IR	Starter Shingle	Portland, OR Fremont, CA	FR	40 x $13^1/_4$, bottom layer; 38 x $11^1/_4$, top layer	4 (top layer)
High Performance Starter	Starter Shingle	Oxford, NC	OX	36 x 10	n/a
Swiftstart	Starter Shingle	Shakopee, MN	SH	$38^3/_4$ x $7^5/_8$	n/a
Universal Starter	Starter Shingle	Avery, OH Oxford, NC Shakopee, MN Shreveport, LA	AV OX SH SP	36 x 7	n/a

For **SI:** 1 inch = 25.4 mm.

TABLE 2—CODE SECTION NUMBER REFERENCE MATRIX

ESR-3537	2024 IBC	2021 IBC	2018 IBC	2015 IBC	2012 IBC	2009 IBC
2.0, 4.1.1	1507.2	1507.2	1507.2	1507.2	1507.2	1507.2
3.6	1507.2.3	1507.2.3	1507.2.3	1507.2.3	1507.2.3	1507.2.3
3.6	1507.2.7	1507.2.7	1507.2.7	1507.2.8.2	1507.2.8.2	1507.2.8.2
4.1.1	2304.8.2 and 2308.11.9	2304.8.2 and 2308.7.10	2304.8.2 and 2308.7.10	2304.8.2 and 2308.7.10	2304.7.2 or 2308.10.8	2304.7.2 or 2308.10.8
4.1.1	Table 1507.1.1(2)	Table 1507.1.1(2)	Table 1507.1.1(2)	1507.2.8	1507.2.8	1507.2.8
4.1.3	1507.2.8.2	Table 1507.2.8.2	Table 1507.2.8.2	Table 1507.2.9.2	Table 1507.2.9.2	Table 1507.2.9.2
4.1.3	1503.2 and 1507.2.8	1503.2 and 1507.2.8	1503.2 and 1507.2.8	1503.2 and 1507.2.9	1503.2 and 1507.2.9	1503.2 and 1507.2.9
4.2	1512	1512	1511	1511	1510	1510
4.2	1512.4 and 1512.5	1512.4 and 1512.5	1511.5 and 1511.6	1511.5 and 1511.6	1510.5 and 1510.6	1510.5 and 1510.6
4.3	1504.2	Table 1504.2	Table 1504.1.1	Table 1504.1.1	Table 1507.2.7.1 (1)	Table 1507.2.7.1 (1)
4.3	1507.2.6	1507.2.6	1507.2.6	1507.2.7	1507.2.7	1507.2.7
ESR-3537	**2024 IRC**	**2021 IRC**	**2018 IRC**	**2015 IRC**	**2012 IRC**	**2009 IRC**
2.0, 4.1.1	R905.2	R905.2	R905.2	R905.2	R905.2	R905.2
3.6	R905.1.1 and Table R905.1.1(1)	R905.1.1 and Table R905.1.1(1)	R905.1.1 and Table R905.1.1(1)	R905.1.1 and Table R905.1.1(1)	R905.2.3	R905.2.3
3.6	R905.2.7	R905.2.7	R905.2.7	R905.2.7	R905.2.7.1	R905.2.7.1
4.1.1	R905.1.1, Tables R905.1.1(2) and R905.1.1(3), and R905.2.3	R905.1.1, Tables R905.1.1(2) and R905.1.1(3), and R905.2.3	R905.1.1, Tables R905.1.1(2) and R905.1.1(3), and R905.2.3	R905.1.1, Tables R905.1.1(2) and R905.1.1(3), and R905.2.3	R905.2.7	R905.2.7
4.1.3	Table R905.2.8.2	Table R905.2.8.2	Table R905.2.8.2	Table R905.2.8.2	Table R905.2.8.2	Table R905.2.8.2
4.1.3	R903.2 and R905.2.8	R903.2 and R905.2.8	R903.2 and R905.2.8	R903.2 and R905.2.8	R903.2 and R905.2.8	R903.2 and R905.2.8
4.2	R908	R908	R908	R908	R907	R907
4.2	R908.5 and R908.6	R908.5 and R908.6	R908.5 and R908.6	R908.5 and R908.6	R907.5 and R907.6	R907.5 and R907.6
4.3	Table R905.2.4.1	Table R905.2.4.1	Table R905.2.4.1	Table R905.2.4.1	Table R905.2.4.1 (1)	Table R905.2.4.1 (1)
4.3	R905.2.6	R905.2.6	R905.2.6	R905.2.6	R905.2.6	R905.2.6


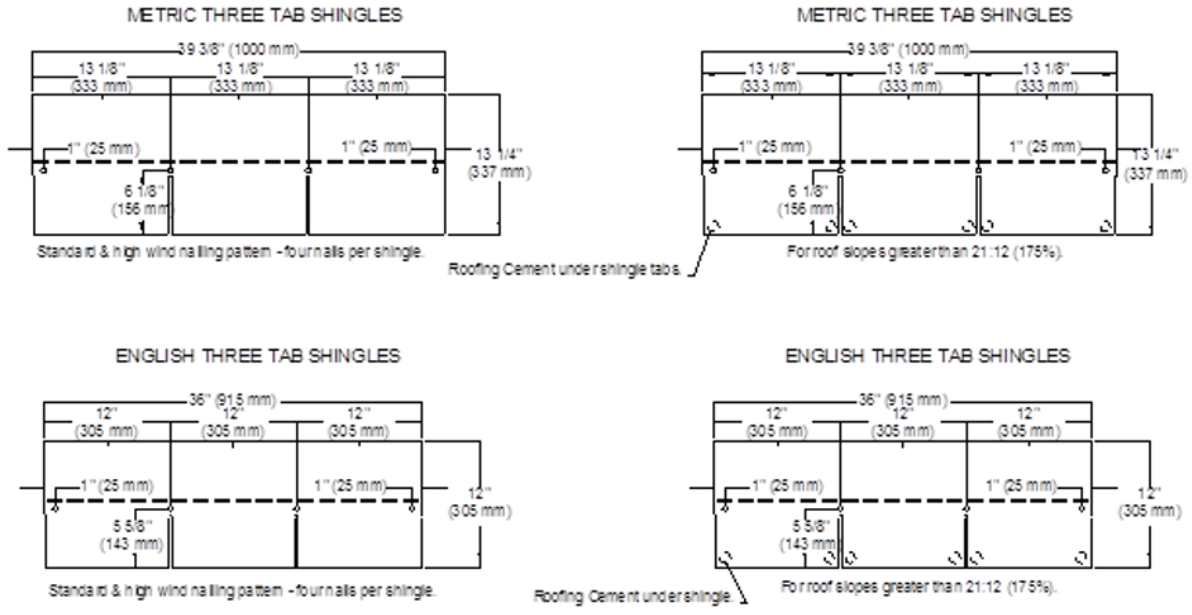



FIGURE 1—SHINGLE PROFILES AND FASTENER PATTERNS

PRESIDENTIAL/PRESIDENTIAL TL SHINGLES

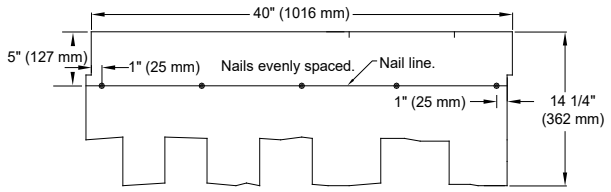

Standard & high wind nailing pattern - five nails per shingle.


PRESIDENTIAL/PRESIDENTIAL TL SHINGLES

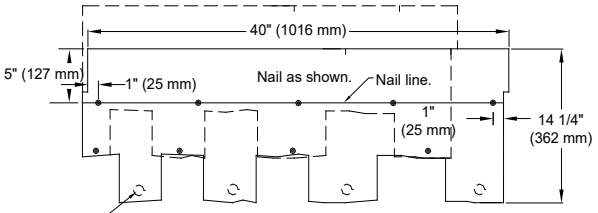

Roofing Cement under shingle.


Nine Nail Pattern. For roof slopes greater than 21:12 (175%).
Overlying shingle must cover extra nails.

METRIC LAMINATES - SEALANT BACK/TAPE BACK

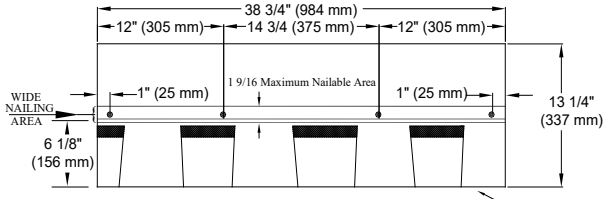

Nailing area for "low and standard" slopes (from 2:12 to 21:12)
Nail between upper & lower nail lines (as shown above).
Standard & high wind nailing pattern - four nails per shingle.

METRIC LAMINATES - SEALANT BACK/TAPE BACK

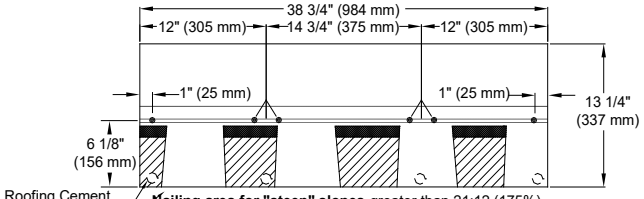


Roofing Cement under shingle.

Nailing area for "steep" slopes greater than 21:12 (175%)
Nail between bottom 2 nail lines (as shown above).
Six Nail Pattern.


Sealant on back.

METRIC LAMINATES - SEALANT BACK/TAPE FRONT

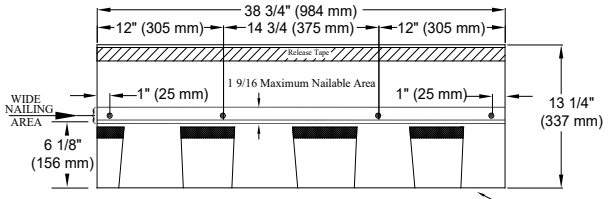

Nailing area for "low and standard" slopes (from 2:12 to 21:12)
Nail between upper & lower nail lines (as shown above).
Standard & high wind nailing pattern - four nails per shingle.

METRIC LAMINATES - SEALANT BACK/TAPE FRONT

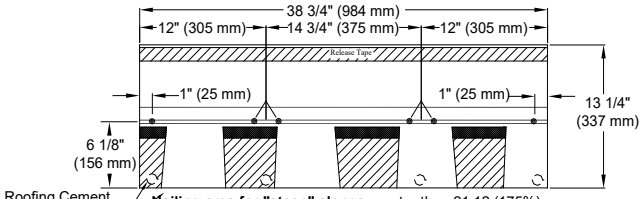


Roofing Cement under shingle.

Nailing area for "steep" slopes greater than 21:12 (175%)
Nail between bottom 2 nail lines (as shown above).
Six Nail Pattern.


Sealant on back.

LANDMARK TL SHINGLES

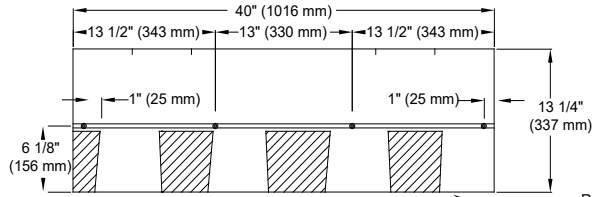

Standard & high wind nailing pattern - four nails per shingle.

LANDMARK TL SHINGLES

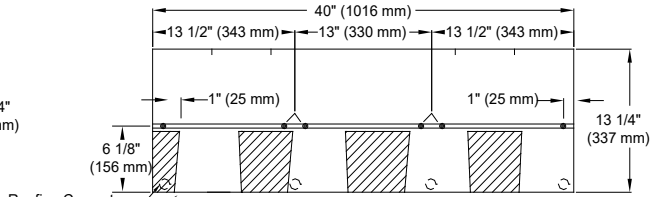

Roofing Cement under shingle.

Six Nail Pattern. For roof slopes greater than 21:12 (175%).

Sealant on back.

FIGURE 1—SHINGLE PROFILES AND FASTENER PATTERNS (Continued)


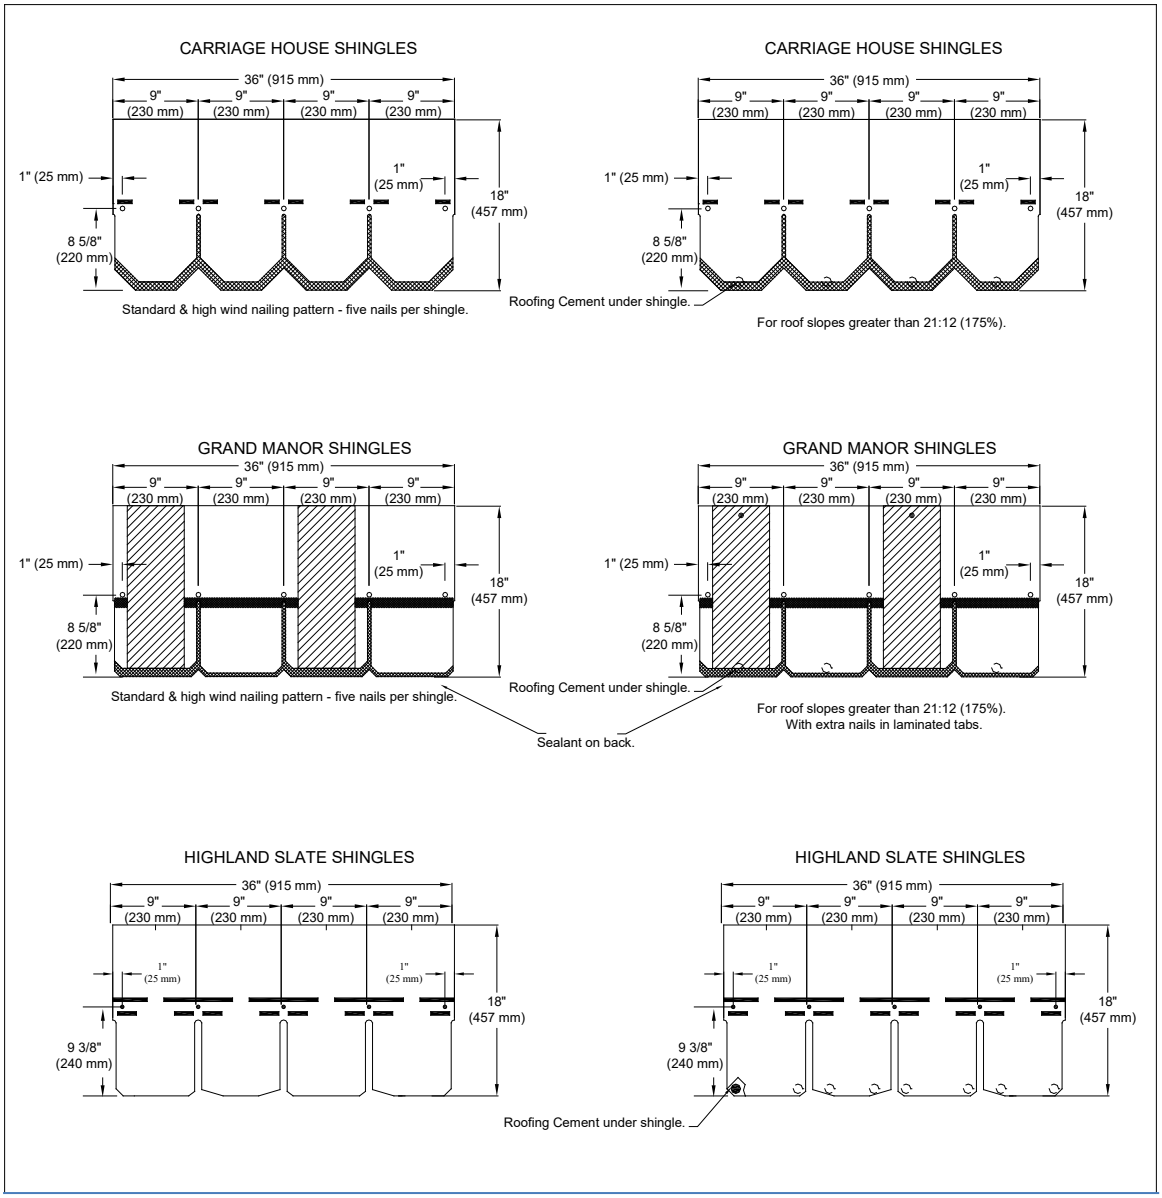



FIGURE 1—SHINGLE PROFILES AND FASTENER PATTERNS (Continued)

ENGLISH
SHADOW RIDGE SHINGLES

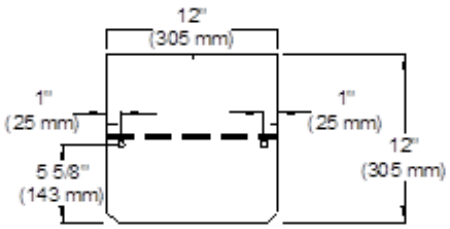


Nailing pattern all applications - two nails per shingle.

SHANGLE RIDGE SHINGLES

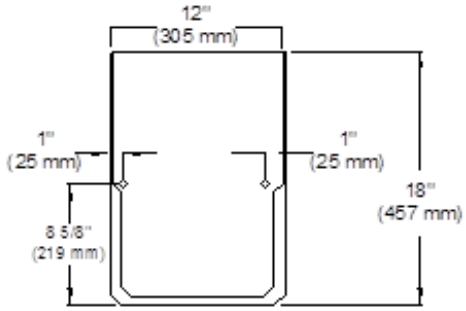


Nailing pattern all applications - two nails per shingle.

METRIC SOLARIS ACCESSORY

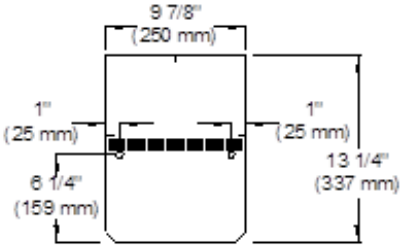


Nailing pattern all applications - two nails per shingle.

METRIC SOLARIS ACCESSORY SHINGLES

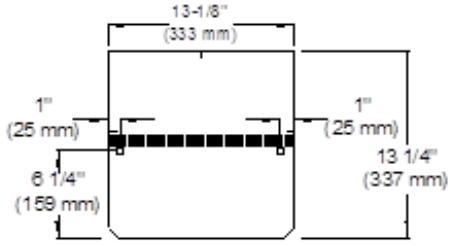


Nailing pattern all applications - two nails per shingle.

10"
MOUNTAIN RIDGE SHINGLES

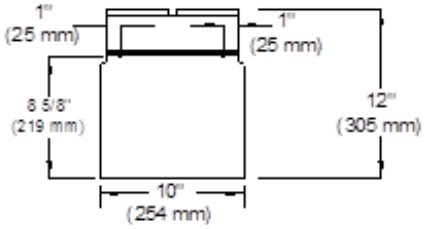

Nailing pattern all applications - two nails per shingle.


8"
MOUNTAIN RIDGE SHINGLES

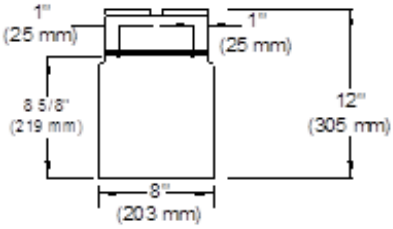

Nailing pattern all applications - two nails per shingle.


FIGURE 1—SHINGLE PROFILES AND FASTENER PATTERNS (Continued)

BELMONT SHINGLES

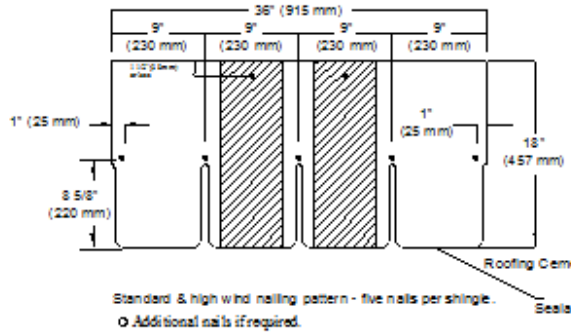


Standard & high wind nailing pattern - five nails per shingle.
O Additional nails if required.

BELMONT SHINGLES

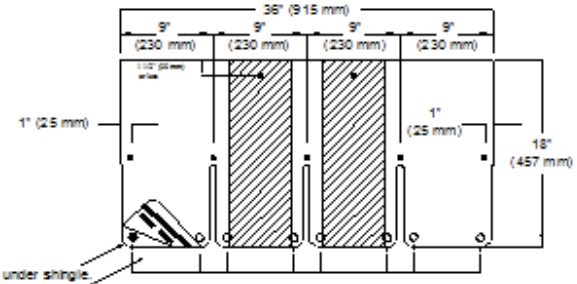


For roof slopes greater than 21:12.
With extra nails in laminated tabs.

PRESIDENTIAL & PRESIDENTIAL IR STARTER SHINGLES

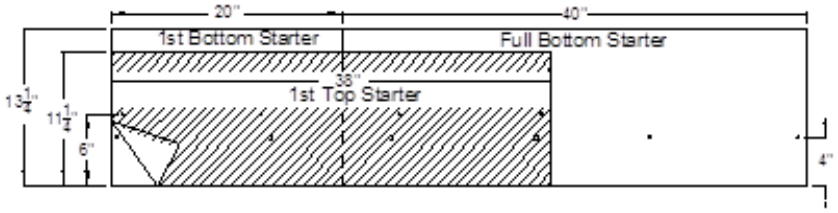


Standard nailing pattern for all slopes from 2/12 (16.7%) up to and exceeding 21/12 (175%) & for high wind application.

SWIFTSTART SHINGLES

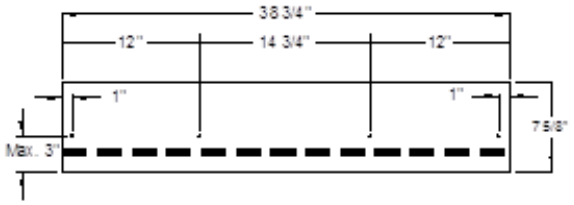


Standard nailing pattern for all slopes from 2/12 (16.7%) up to and exceeding 21/12 (175%) & for high wind application.

UNIVERSAL STARTER SHINGLES

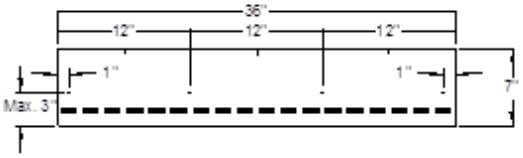

Standard nailing pattern for all slopes from 2/12 (16.7%) up to and exceeding 21/12 (175%) & for high wind application.

HIGH-PERFORMANCE STARTER SHINGLES

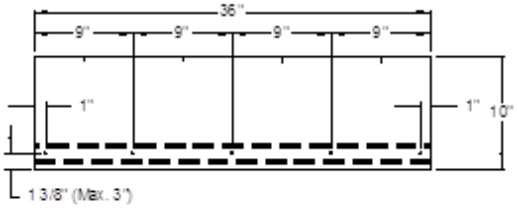

Standard nailing pattern for all slopes from 2/12 (16.7%) up to and exceeding 21/12 (175%) & for high wind application.

FIGURE 1—SHINGLE PROFILES AND FASTENER PATTERNS (Continued)

DIVISION: 07 00 00—THERMAL AND MOISTURE PROTECTION
Section: 07 31 13—Asphalt Shingles

REPORT HOLDER:

CERTAINTEED LLC

EVALUATION SUBJECT:

CERTAINTEED ASPHALT SHINGLES

1.0 REPORT PURPOSE AND SCOPE

Purpose:

The purpose of this evaluation report supplement is to indicate that CertainTeed LLC asphalt shingles, described in ICC-ES evaluation report ESR-3537, have also been evaluated for compliance with the codes noted below.

Applicable code editions:

- 2025 *California Building Code*® (CBC)

For evaluation of applicable chapters adopted by the California Office of Statewide Health Planning and Development (OSHPD) AKA: California Department of Health Care and Information (HCAI) and the Division of State Architect (DSA), see Sections 2.1.1 and 2.1.2 below.

- 2025 *California Residential Code*® (CRC)

2.0 CONCLUSIONS

2.1 CBC:

The CertainTeed LLC asphalt shingles, described in Sections 2.0 through 7.0 of the evaluation report ESR-3537, comply with CBC Sections 1505.1 and 1507.2, and may be used where the CBC requires a Class A roof covering complying with CBC Section 1505.1.1, or at least a Class C roof covering complying with CBC Section 1505.1.2, provided the design and installation are in accordance with the 2024 *International Building Code*® (IBC) provisions respectively, noted in the evaluation report and the additional requirements of CBC Section 1512, as applicable.

The classified Class A roof covering may be used in the construction of new buildings located in any Fire Hazard Severity Zone within a State Responsibility Areas or any Wildland-Urban Interface Fire Area, provided installation is in accordance with the 2024 *International Building Code*® (IBC) provisions, as applicable, noted in the evaluation report and the additional requirements of Sections 101.3.1, 504.2 and 507.1 of the 2025 *California Wildland-Urban Interface Code*® (CWUIC)..

2.1.1 OSHPD: The applicable OSHPD Sections and Chapters of the CBC are beyond the scope of this supplement.

2.1.2 DSA: The applicable DSA Sections and Chapters of the CBC are beyond the scope of this supplement.

2.2 CRC:

The CertainTeed LLC asphalt shingles, described in Sections 2.0 through 7.0 of the evaluation report ESR-3537, comply with CRC Sections R902.1 and R905.2, and may be used where the CRC requires a Class A roof covering complying with CRC Section R902.1.1 or at least a Class C roof covering complying with CRC Section R902.1.2, provided the design and installation are in accordance with the 2024 *International Residential Code*® (IRC) provisions respectively, noted in the evaluation report and the additional requirements of CRC Section R908, as applicable.

ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.

Copyright © 2026 ICC Evaluation Service, LLC. All rights reserved.

The classified Class A roof covering may be used in the construction of new buildings located in any Fire Hazard Severity Zone within a State Responsibility Areas or any Wildland-Urban Interface Fire Area, provided installation is in accordance with the 2024 *International Residential Code*® (IRC) provisions, as applicable, noted in the evaluation report and the additional requirements of Sections 101.3.1, 504.2 and 507.1 of the 2025 *California Wildland-Urban Interface Code*® (CWUIC).

The products recognized in this supplement have not been evaluated for compliance with the *International Wildland–Urban Interface Code*®.

This supplement expires concurrently with the evaluation report, reissued June 2026 and revised October 2026.